




LOWER LEVEL

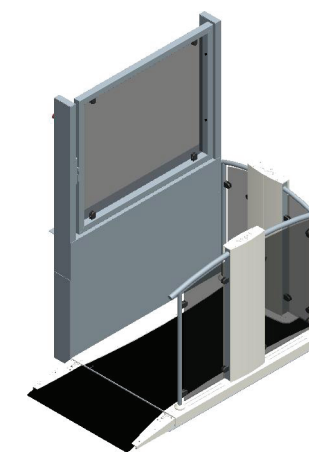

UPPER LEVEL

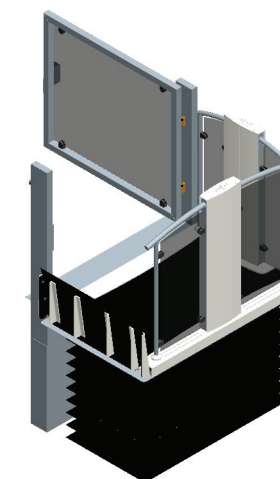


CLEARANCE EITHER SIDE OF STEPLIFT MUST BE <10mm OR >150mm TO COMPLY WITH BS6440.

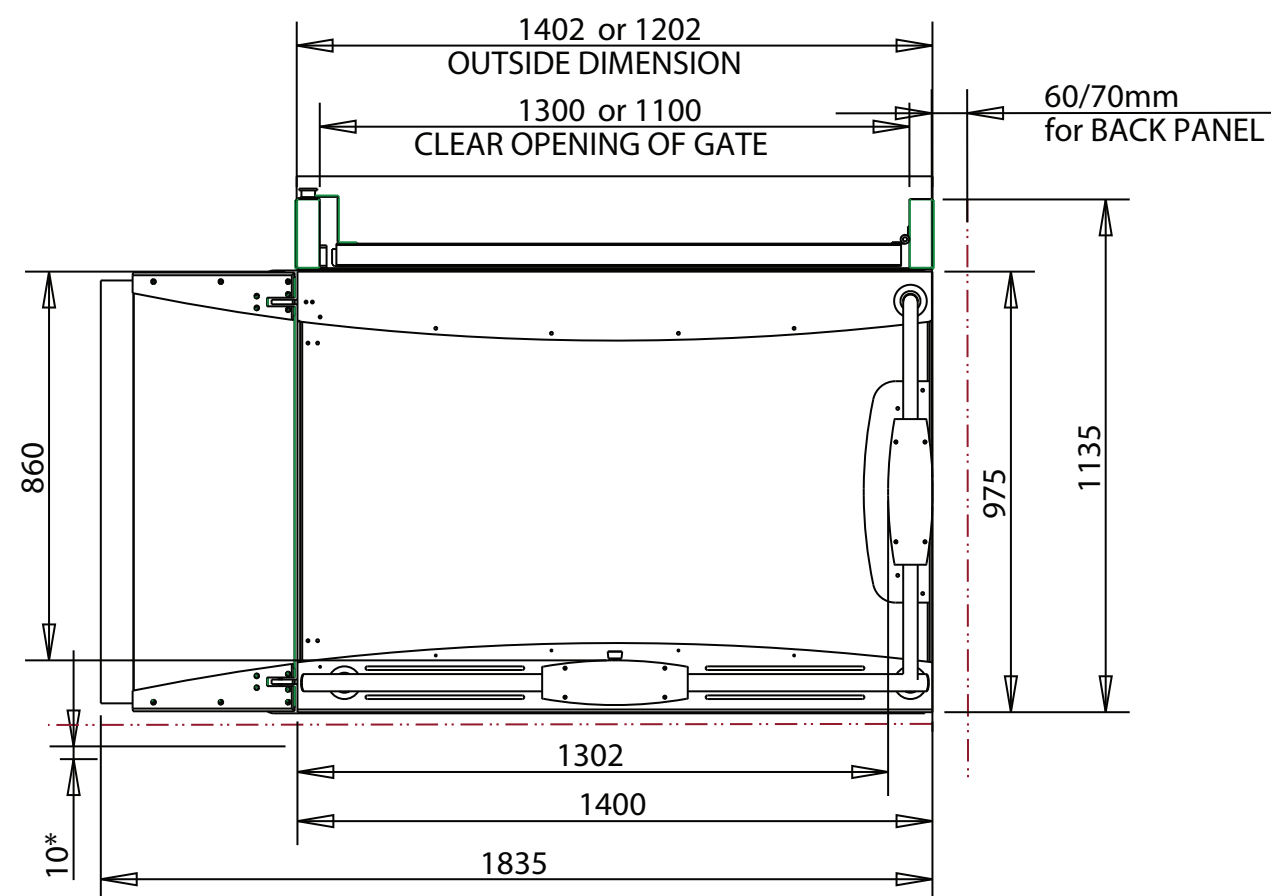

740x1400  
STEPLIFT  
ADJACENT ENTRY

NOTE: THIS DRAWING IS FOR GUINANCE ONLY AND MUST NOT BE USED AS A PROPER WORKING DRAWING. FOR ENQUIRIES ABOUT THE LIFT PLEASE CONTACT THE AXESS 2.

Drawing Title: <b>A2 Step Lift - 740 Adjacent Entry</b>		Drawing Number: <b>-</b>
Date: <b>24/01/12</b>	Scale: <b>NTS</b>	Rev:
Drawn By: <b>N Massey</b>	Checked By: <b>N Cardwell</b>	
<div>Unit 7, Deanfield Drive, Link 59 Business Park, Clitheroe, Lancs, BB7 1QJ, <b>Tel:</b> 01200 405005 <b>Fax:</b> 01200 405006 <b>Email:</b> info@axess2.co.uk</div> <div><div>axess</div><div>Lifts for life</div><div></div></div> <div>www.axess2.co.uk</div>		

**axess**   
Lifts for life

www.axess2.co.uk