



LOWER LEVEL

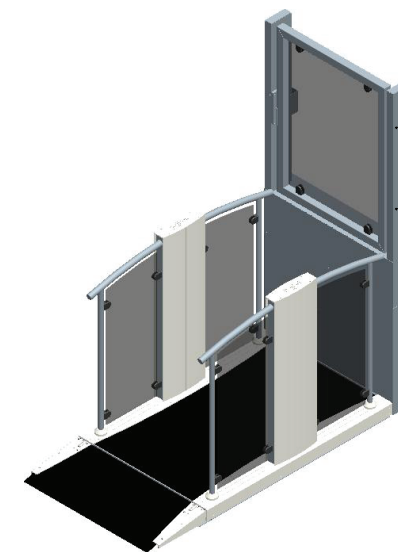


UPPER LEVEL

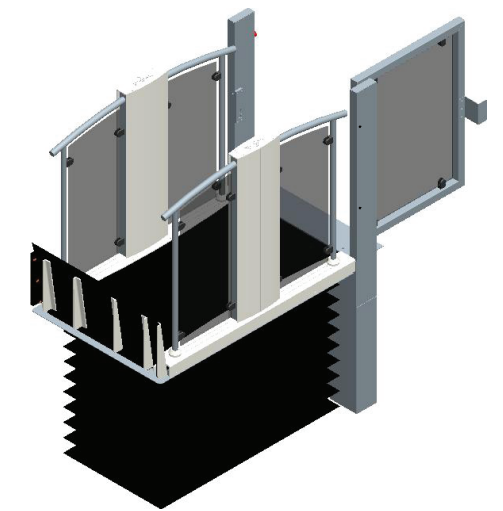


CLEARANCE EITHER SIDE OF STEPLIFT MUST BE <10mm OR >150mm TO COMPLY WITH BS6440.

740x1400
STEPLIFT
THROUGH ENTRY

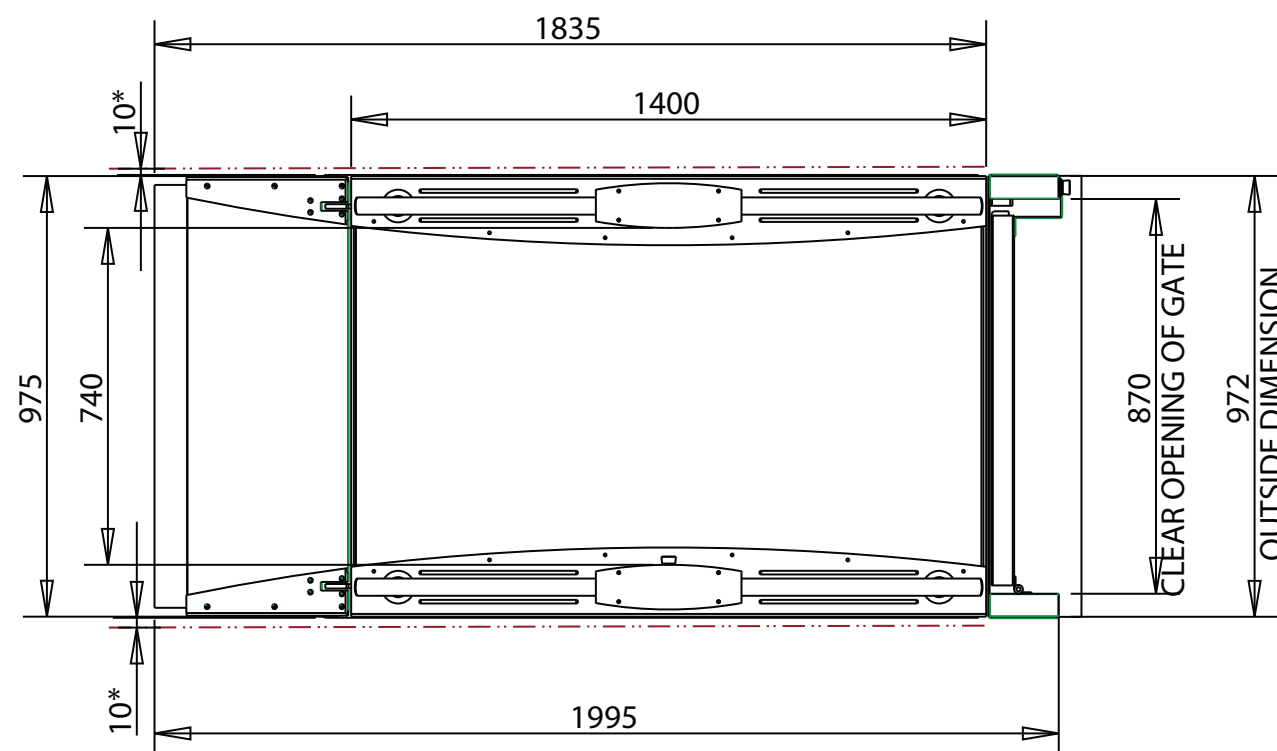

NOTE: THIS DRAWING IS FOR GUINANCE ONLY AND MUST NOT BE USED AS A PROPER WORKING DRAWING. FOR ENQUIRIES ABOUT THE LIFT PLEASE CONTACT THE AXESS 2.

Drawing Title: A2 Step Lift - 740 Through Entry		Drawing Number: ■
Date: 24/01/12	Scale: NTS	Rev:
Drawn By: N Massey	Checked By: N Cardwell	
Unit 7, Deanfield Drive, Link 59 Business Park, Clitheroe, Lancs, BB7 1QJ, Tel: 01200 405005 Fax: 01200 405006 Email: info@axess2.co.uk		axess  Lifts for life www.axess2.co.uk