



## **Gibraltar Strip Steel, Inc.**

### **HARMONIC STUDY**

Prepared By  
Pierre Archambault, PEng  
Power Survey International Inc.  
8025 Trans Canada Hwy.  
St-Laurent, QC  
H4S 1S4  
CANADA

18 August 2005

## TABLE OF CONTENTS

<b>1.</b>	<b>GENERAL</b>
1.1	Purpose of this Study
1.2	Data
1.3	Assumptions
1.4	Simulation One Line Diagram
1.5	Load Flow One Line Diagram
<b>2.</b>	<b>RESULTS</b>
2.1	Scenario 1: no Filters
2.3	Scenario 2: 4 MVAR - 5 <sup>th</sup> harmonic filter
2.4	Scenario 3: 4 MVAR - 5 <sup>th</sup> , 7 <sup>th</sup> and 11 <sup>th</sup> harmonic filter
<b>3.</b>	<b>CONCLUSIONS</b>
3.1	Comparing Scenarios
3.2	Recommendations
<b>4.</b>	<b>APPENDIX</b>
4.1	One Line Diagram
4.2	Thermoelectric Solutions Inc. Survey
4.3	Illuminating Company Report

## 1. GENERAL

### 1.1 Purpose of this Study

The purpose of this study is to check the influence of harmonic filters, sized for optimum power factor compensation, keeping harmonic distortion at the Point of Common Coupling in compliance with IEEE 519 guidelines. This study is based on the ETAP Power Station simulation software version 5.0.2 and electrical data as indicated in Section 1.2

### IEEE 519 Guidelines for Current Distortion

IEEE Std 519-1992

IEEE RECOMMENDED PRACTICES AND REQUIREMENTS

**Table 10-3—Current Distortion Limits for General Distribution Systems (120 V Through 69 000 V)**

Maximum Harmonic Current Distortion in Percent of $I_L$						
Individual Harmonic Order (Odd Harmonics)						
$I_{sc}/I_L$	<11	$11 \leq h < 17$	$17 \leq h < 23$	$23 \leq h < 35$	$35 \leq h$	TDD
<20*	4.0	2.0	1.5	0.6	0.3	5.0
20<50	7.0	3.5	2.5	1.0	0.5	8.0
50<100	10.0	4.5	4.0	1.5	0.7	12.0
100<1000	12.0	5.5	5.0	2.0	1.0	15.0
>1000	15.0	7.0	6.0	2.5	1.4	20.0

Even harmonics are limited to 25% of the odd harmonic limits above.

Current distortions that result in a dc offset, e.g., half-wave converters, are not allowed.

\* All power generation equipment is limited to these values of current distortion, regardless of actual  $I_{sc}/I_L$ .

where  
 $I_{sc}$  = maximum short-circuit current at PCC.  
 $I_L$  = maximum demand load current (fundamental frequency component) at PCC.

Assuming  $I_{sc}/I_L = 15.140 / 610 = 24.82$ , the current distortion limits are:

- 7% for <10th harmonics
- 3.5% for 11th to 16th harmonics
- 2.5% for 17th to 22nd harmonics
- 1.0% for 23rd to 34th harmonics
- 0.5% for 35th and higher harmonics
- 8.0% for THD-I values

## IEEE 519 Guidelines for Voltage Distortion

**Table 10-2—Low-Voltage System Classification and Distortion Limits**

	Special Applications <sup>*</sup>	General System	Dedicated System <sup>†</sup>
Notch Depth	10%	20%	50%
THD (Voltage)	3%	5%	10%
Notch Area ( $A_N$ ) <sup>‡</sup>	16 400	22 800	36 500

NOTE — The value  $A_N$  for other than 480 V systems should be multiplied by  $V/480$

\*Special applications include hospitals and airports.

†A dedicated system is exclusively dedicated to the converter load.

‡In volt-microseconds at rated voltage and current.

## **1.2 Data**

The following documents were available and used for programming the ETAP simulation model:

- Gibraltar Strip Steel Electrical System Survey One Line Diagram (Thermoelectric Solutions Inc.)
- Gibraltar Strip Steel Capacitor Survey, with Appendixes A to F as follows:
  - Section A: Electrical Power Trend Data, 7 Pages
  - Section B: Harmonic Current and Voltage Data, 50 Pages
  - Section C: First Energy Company Impedance Data, 2 Pages
  - Section D: Electric Bill Summary, 1Page
  - Section E: Electric Rate Schedule, 7 Pages
  - Section F: Sample Electric Bill, 7 Pages

### 1.3 Assumptions

Following the data specified above and having installed the one line diagram on ETAP, a load flow run was performed assuming a 75% service factor for all loads.


The utility short circuit capacity was set 299 MVA at 11.4 kV

Utility Impedance Values (100 MVA base):

Positive Sequence: R = 4.5452 % X = 33.1345%


0 Sequence: R = 31.0592 % X = 99.3895 %

Drive Harmonic Current Injection for all Drives - Typical IEEE 6-pulse (with some minor adjustments), as follows:

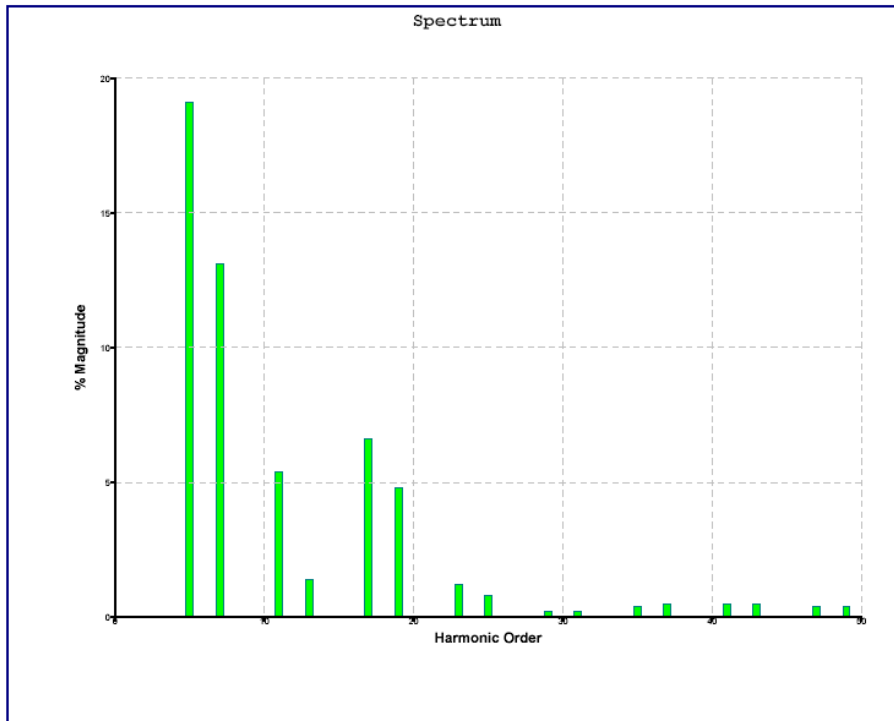


n	%
5	19.10
7	13.10
11	5.40
13	1.40
17	6.60
19	4.80
23	1.20
25	0.80
29	0.20
31	0.20
35	0.40
37	0.50
41	0.50
43	0.50
47	0.40
49	0.40


## 1.4 Simulation One Line Diagram

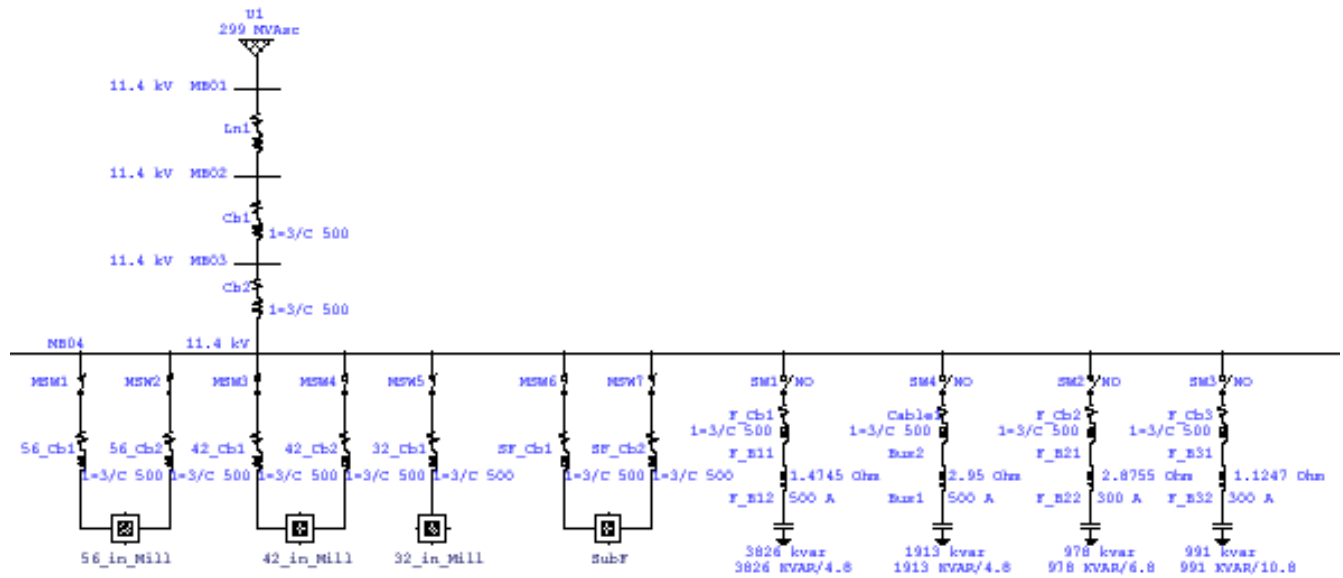

One-Line Diagram - OLV1=>56 in Mill

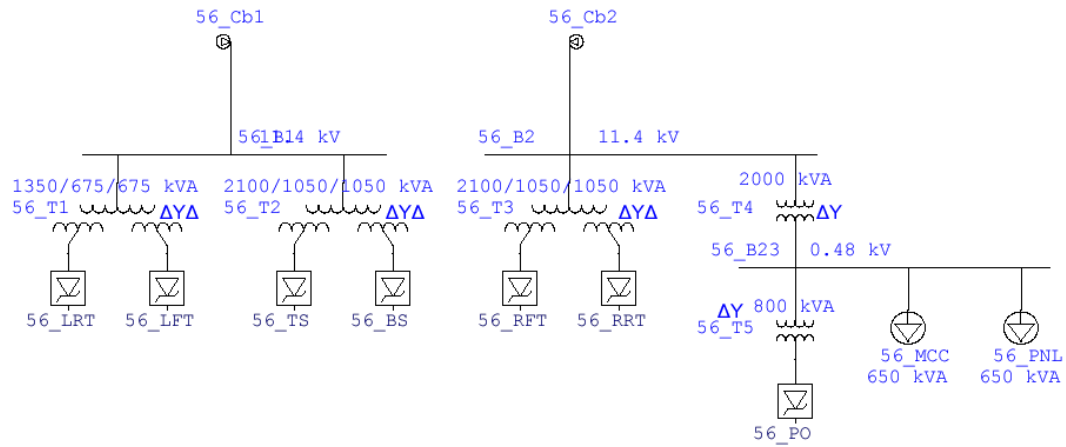


One-Line Diagram - OLV1=>42 in Mill

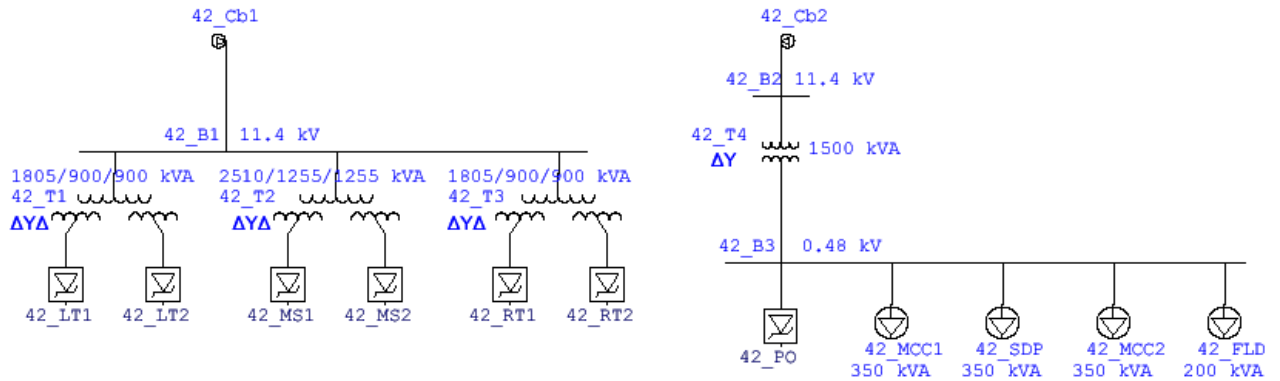




One-Line Diagram - OLV1=>32\_in\_Mill

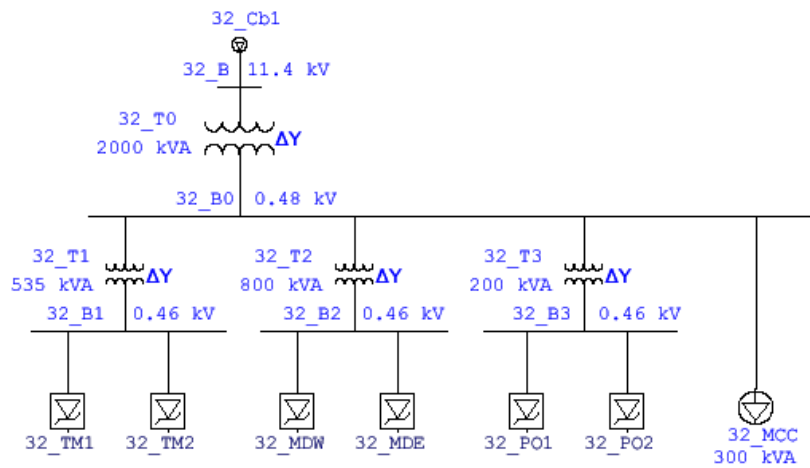


One-Line Diagram - OLV1=>SubF

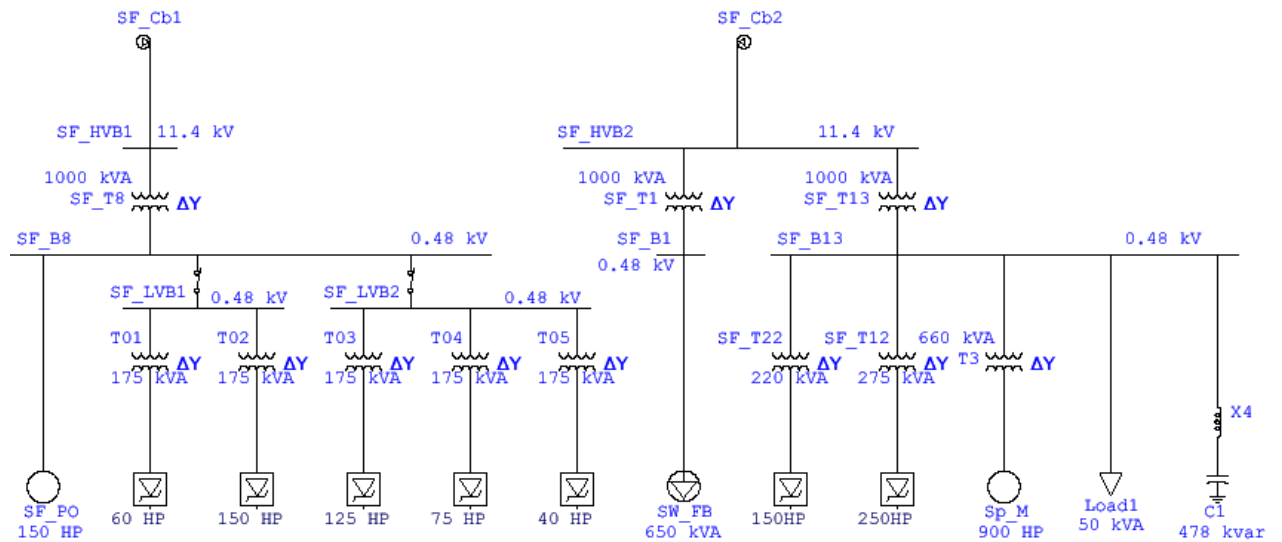


## 1.5 Load Flow One Line Diagram

Scenario 1: No Filters

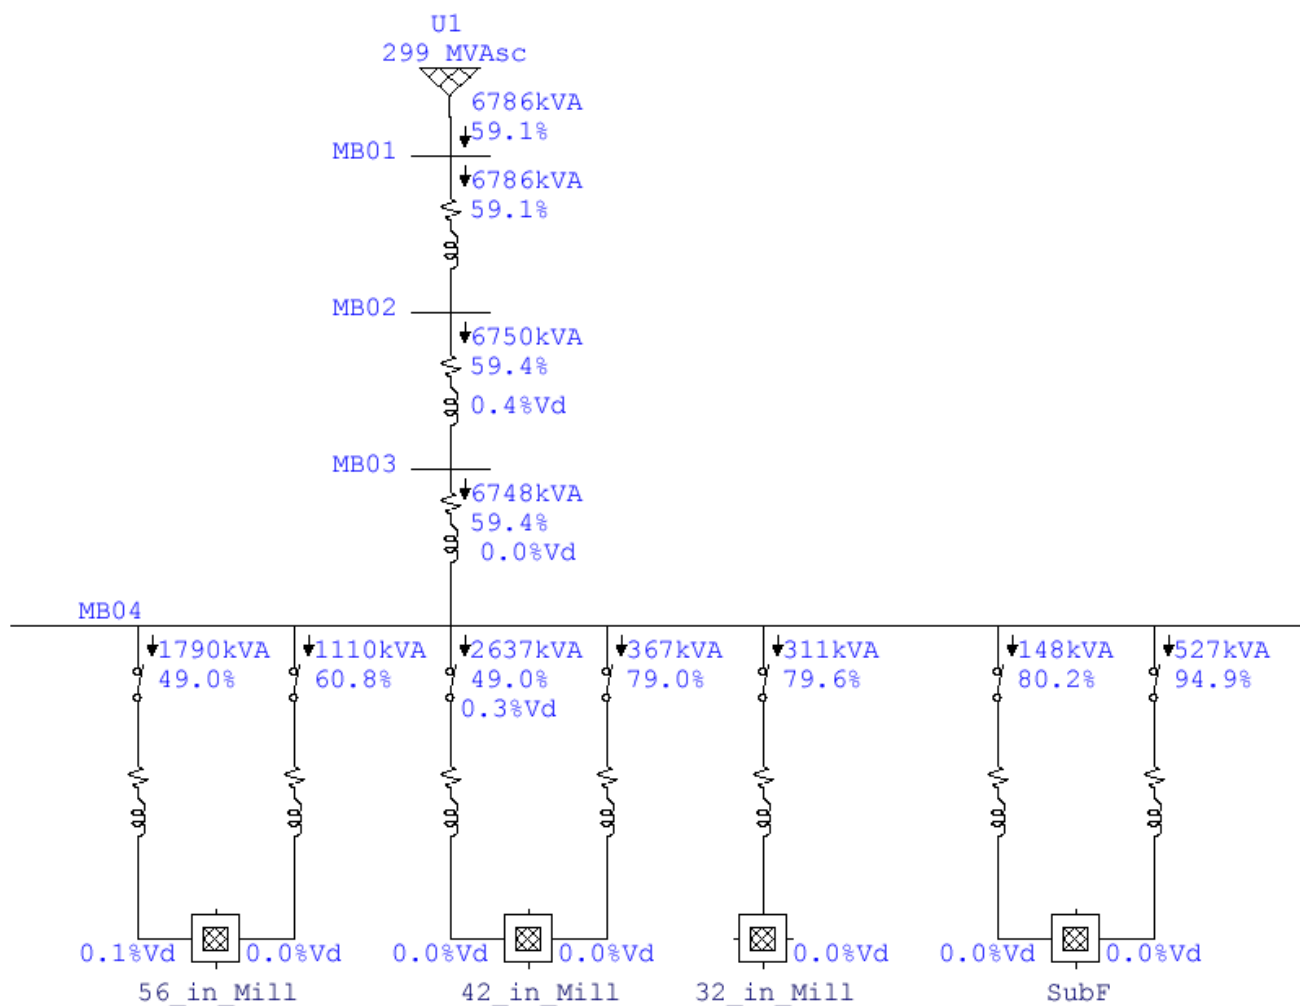

Scenario 3: 4MVAR - 5<sup>th</sup>, 7<sup>th</sup> and 11<sup>th</sup> Harmonic Filter

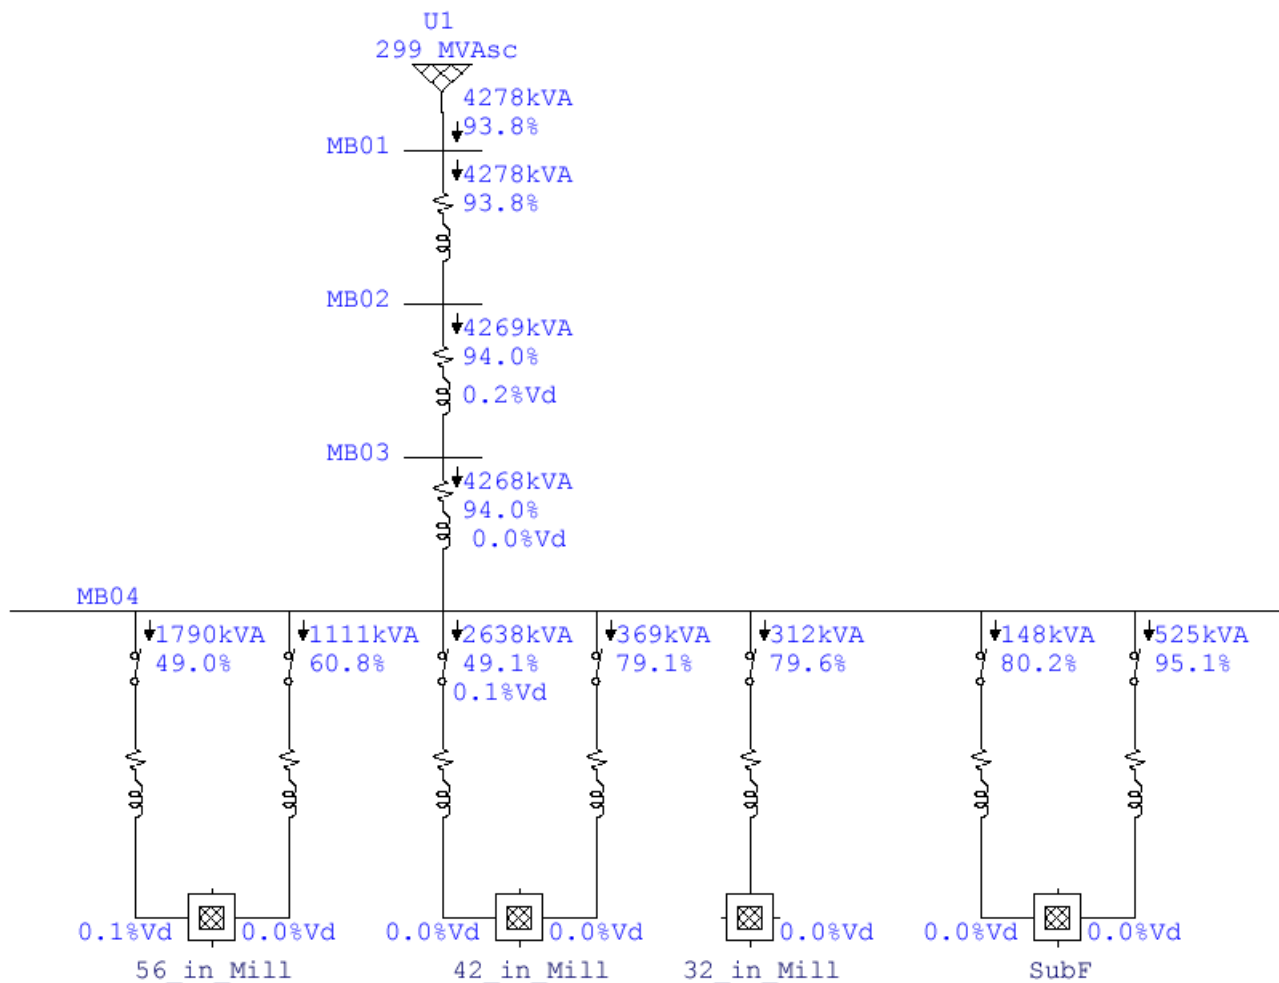


## 2. RESULTS

### 2.1 Scenario 1: No Filters

The load flow obtained by the simulation show a total load of 6786 KVA (PF = 59.1%). The harmonic current spectrum at the main supply line Ln1 indicates acceptable current THD (4.21% < 8%). There is infringement of the maximum limit for the 11th harmonic current as indicated in red in the table below. The voltage THD at the main bus MB01 is 1.26%, within the limit (5%) stipulated by IEEE 519.

#### CURRENT SPECTRUM – MAIN SUPPLY LINE Ln1:

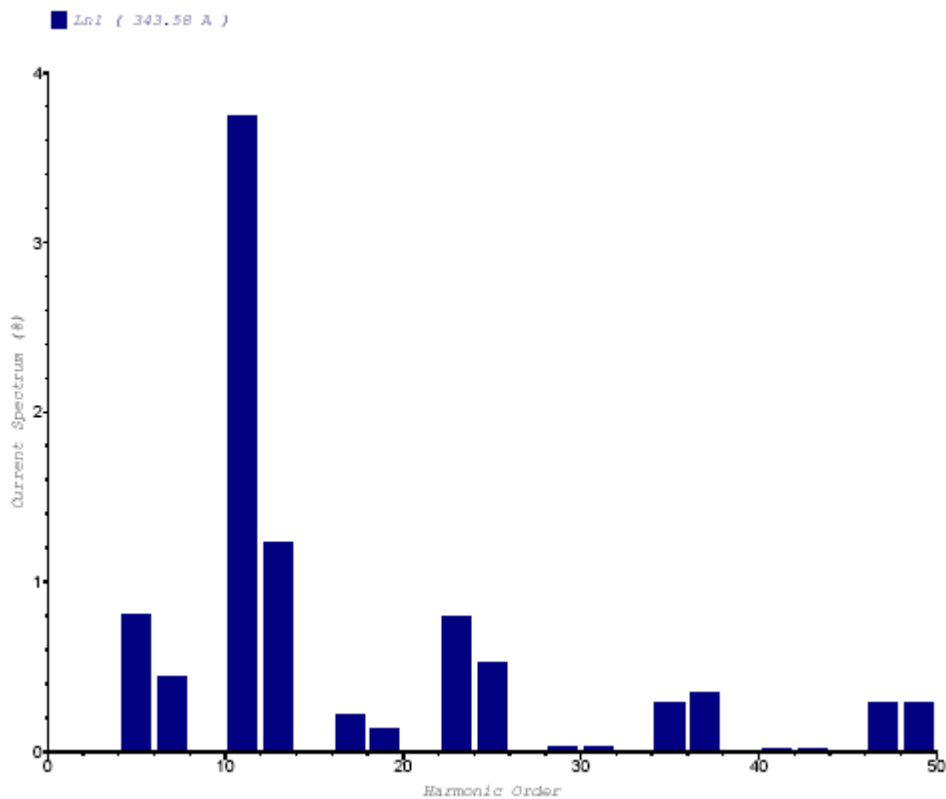


#### Comment

The 5<sup>th</sup> and 7<sup>th</sup> harmonic currents cannot be caused by the large 12-pulse drives, not even considering a reasonable voltage unbalance and / or phase shift in the three winding transformers, not even a major drive fault, operating one large drive with only 6-pulses. The higher than predicted 5<sup>th</sup> and 7<sup>th</sup> harmonic currents could though be caused by other users - which were not considered in this model - connected at the same 11.4 kV power line. The 5<sup>th</sup> and 7<sup>th</sup> harmonic currents do not represent though any problem, as their distortion levels are sufficiently low in % value.

HARMONIC STUDY  
Gibraltar Strip Steel, Inc.

VOLTAGE SPECTRUM - MAIN SUPPLY BUSES MB01 and MB04:

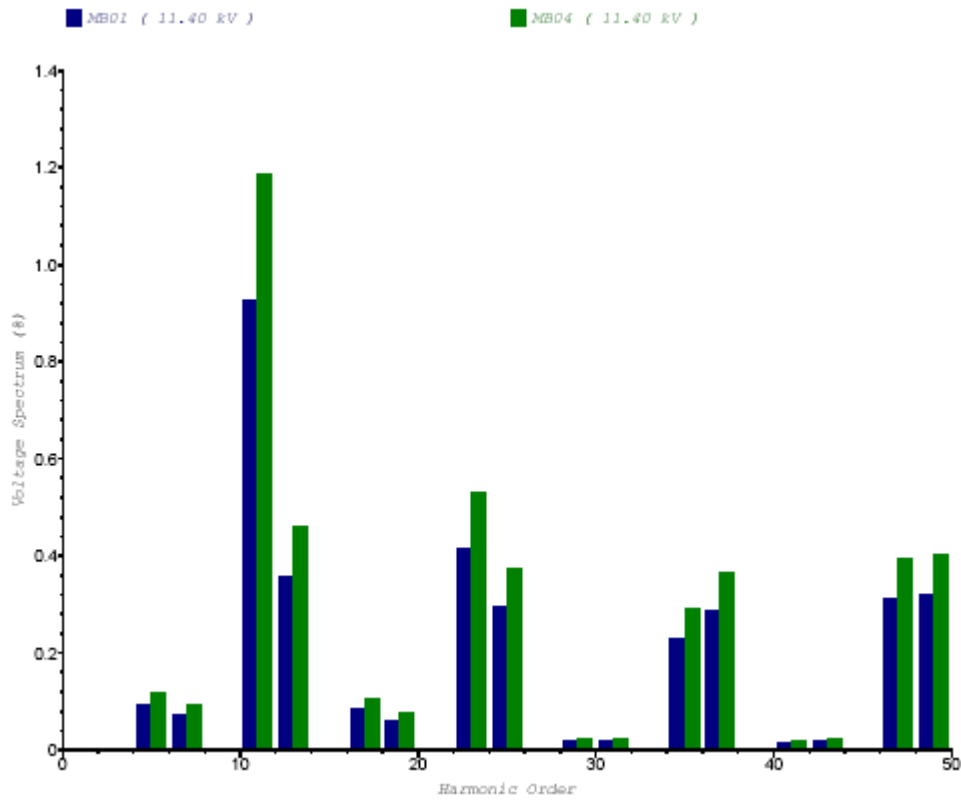


Bus	MB01	MB04
1	100%	100%
5	0.0914	0.1183
7	0.0707	0.0911
11	0.9243	1.1870
13	0.3588	0.4601
17	0.0836	0.1069
19	0.0603	0.0771
23	0.4144	0.5287
25	0.2939	0.3746
29	0.0177	0.0225
31	0.0180	0.0229
35	0.2289	0.2910
37	0.2868	0.3645
41	0.0135	0.0171
43	0.0181	0.0230
47	0.3105	0.3937
49	0.3186	0.4037
THD	1.2645	1.6178

## 2.2 Scenario 2: 4 MVAR 5<sup>th</sup> harmonic filter

One 4 MVAR 5th harmonic filter (tuned at 4.8 h) was connected on the simulation. The harmonic current spectrum in the main supply line indicates a better 5<sup>th</sup> harmonic distortion (only 0.31%) and a still acceptable current THD of 4.59%. But it is apparent that an 11<sup>th</sup> harmonic filter should be included: the harmonic distortion increased from 3.74% to 4.13%, higher than the IEEE 519 limit of 3.5%. The voltage THD at the main supply bus is 0.91%, falling well below the IEEE 519 limit of 5%.


### CURRENT SPECTRUM – MAIN SUPPLY LINE Ln1:

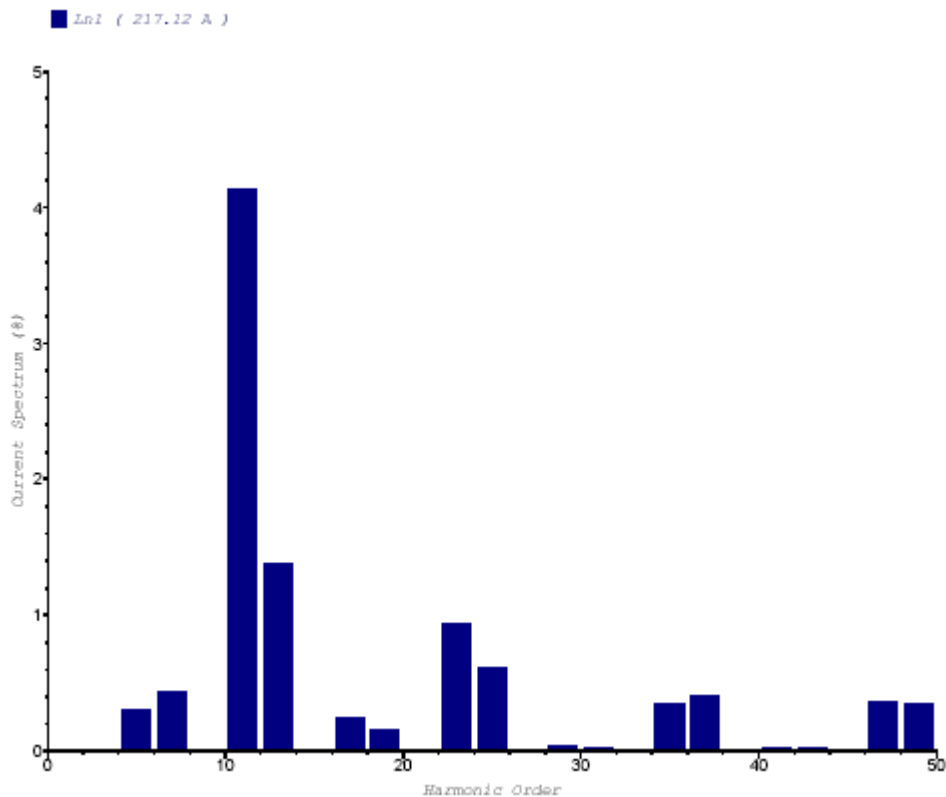

Line	Ln1
1	100%
5	0.3051
7	0.4286
11	4.1259
13	1.3825
17	0.2513
19	0.1634
23	0.9350
25	0.6122
29	0.0319
31	0.0305
35	0.3459
37	0.4112
41	0.0175
43	0.0225
47	0.3554
49	0.3508
THD	4.5925

HARMONIC STUDY  
Gibraltar Strip Steel, Inc.

VOLTAGE SPECTRUM - MAIN SUPPLY BUSES MB01 and MB04:

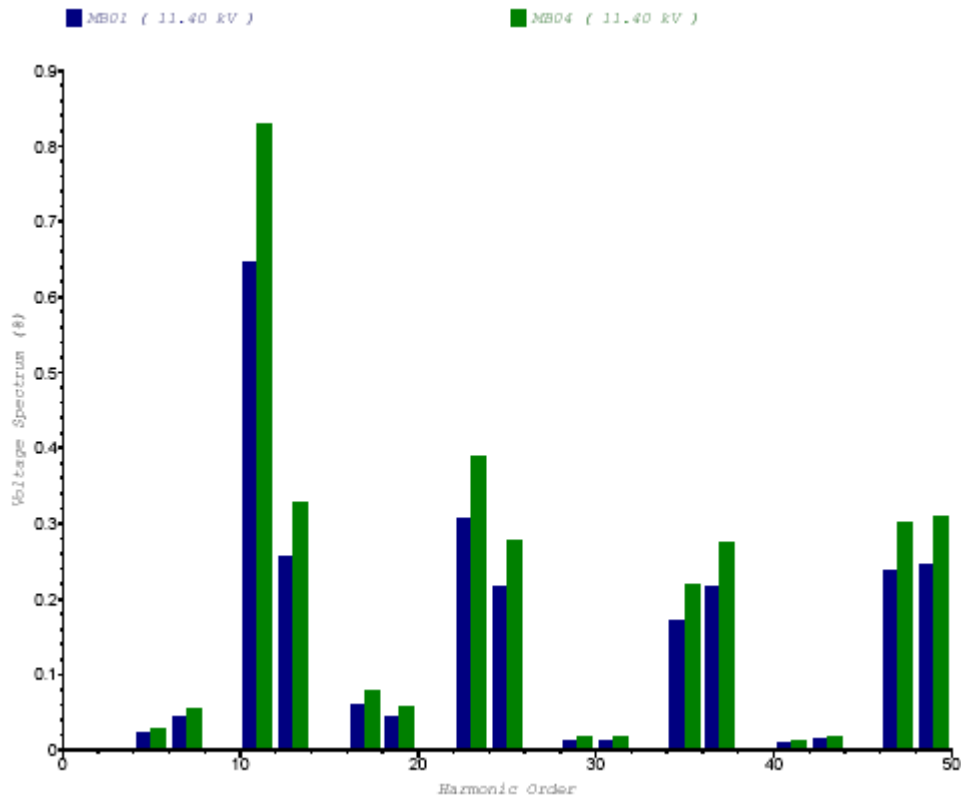


Bus	MB01	MB04
1	100%	100%
5	0.0217	0.0280
7	0.0426	0.0550
11	0.6447	0.8280
13	0.2553	0.3274
17	0.0607	0.0776
19	0.0441	0.0564
23	0.3055	0.3898
25	0.2174	0.2772
29	0.0132	0.0168
31	0.0134	0.0171
35	0.1720	0.2186
37	0.2161	0.2746
41	0.0102	0.0129
43	0.0138	0.0175
47	0.2373	0.3008
49	0.2440	0.3094
THD	0.9067	1.1597

### 2.3 Scenario 3: 2 MVAR 5<sup>th</sup>, 1 MVAR 7<sup>th</sup> and 1 MVAR 11<sup>th</sup> harmonic filters

A combination of 5<sup>th</sup>, 7<sup>th</sup> and 11<sup>th</sup> harmonic filters (tuned at 4.8 h, 6.8 h and 10.8 h) are connected now. The harmonic current spectrum in the main supply line indicates better harmonic distortions and better current THD (1.72%). The 11<sup>th</sup> harmonic distortion decreased from 4.13% to 1.08%, falling below the IEEE 519 limit of 3%. Voltage THD at the main supply bus is only 0.474%, well below the IEEE 519 limit of 5%.

#### CURRENT SPECTRUM – MAIN SUPPLY LINE Ln1:

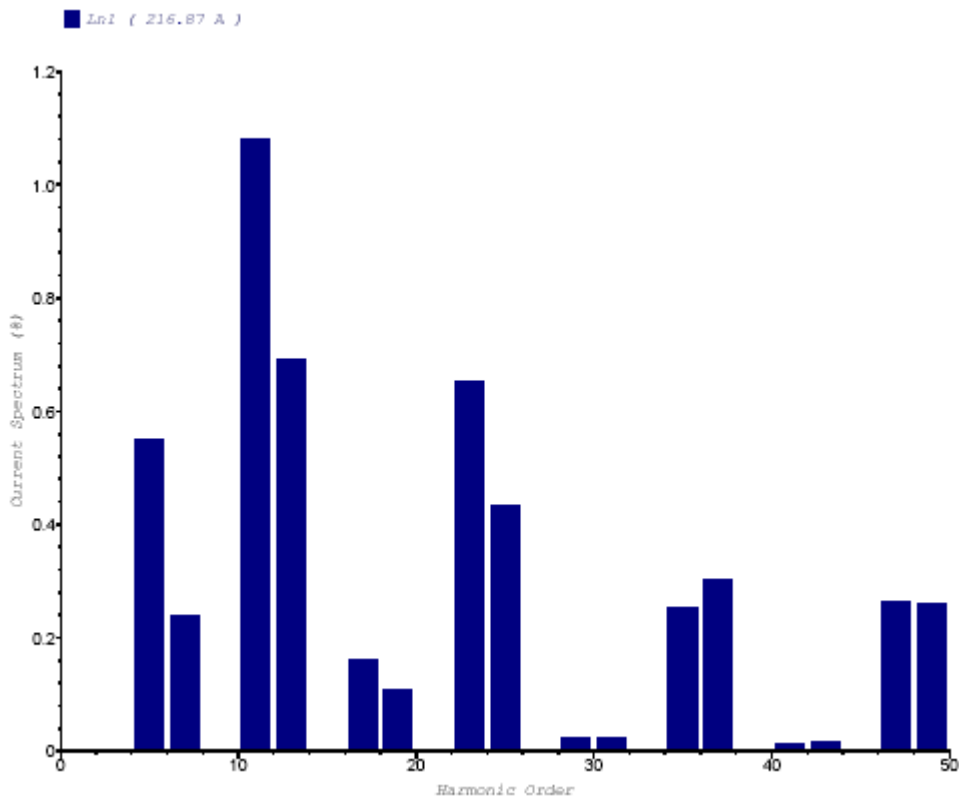


Line	Ln1
1	100%
5	0.5503
7	0.2398
11	1.0799
13	0.6903
17	0.1610
19	0.1091
23	0.6523
25	0.4326
29	0.0229
31	0.0221
35	0.2523
37	0.3009
41	0.0129
43	0.0166
47	0.2632
49	0.2602
THD	1.7164



HARMONIC STUDY  
Gibraltar Strip Steel, Inc.

VOLTAGE SPECTRUM - MAIN SUPPLY BUSES MB01 and MB04:

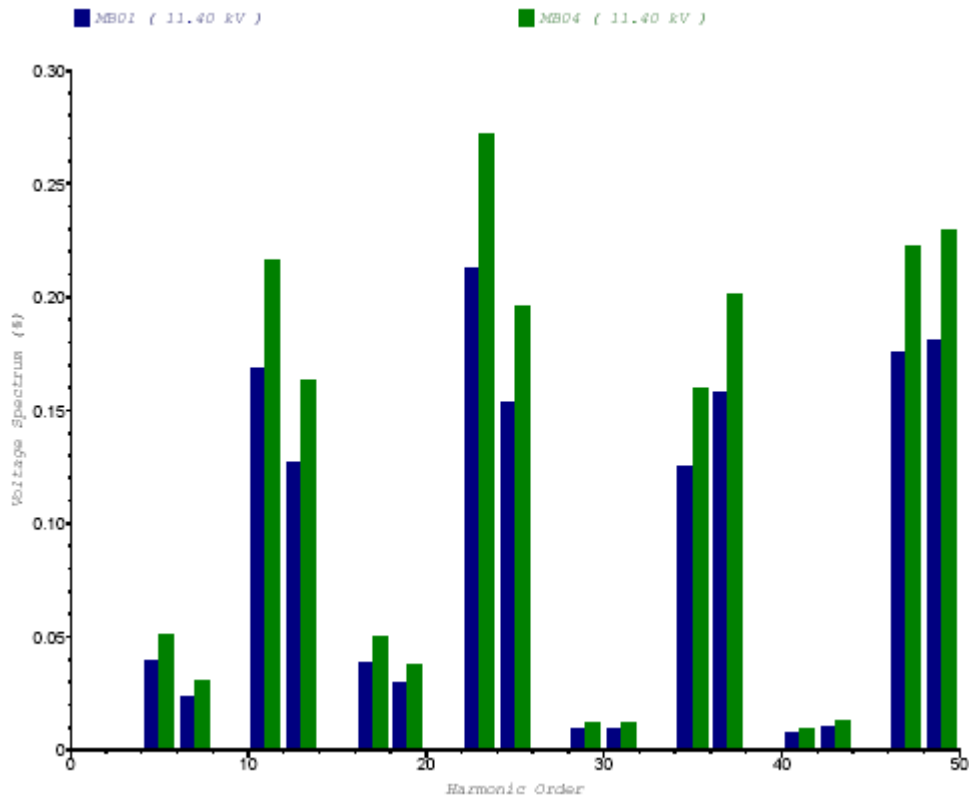

Bus	MB01	MB04
1	100%	100%
5	0.0391	0.0505
7	0.0238	0.0307
11	0.1686	0.2165
13	0.1273	0.1633
17	0.0388	0.0497
19	0.0294	0.0376
23	0.2129	0.2716
25	0.1534	0.1956
29	0.0094	0.0120
31	0.0097	0.0124
35	0.1253	0.1593
37	0.1580	0.2007
41	0.0075	0.0095
43	0.0101	0.0129
47	0.1755	0.2225
49	0.1809	0.2292
THD	0.4717	0.6010

### 3. CONCLUSIONS

#### 3.1 Comparing Scenarios

The following table highlights the results for current and voltage harmonics (in % values, unless otherwise stated) at the PCC:

Scenario No	Current Distortions - Line Ln1			Voltage Distortions - Bus MB01		
	1	2	3	1	2	3
1	100%	100%	100%	100%	100%	100%
5	0.8131	0.3051	0.5503	0.0914	0.0217	0.0391
7	0.4490	0.4286	0.2398	0.0707	0.0426	0.0238
11	3.7378	4.1259	1.0799	0.9243	0.6447	0.1686
13	1.2277	1.3825	0.6903	0.3588	0.2553	0.1273
17	0.2187	0.2513	0.1610	0.0836	0.0607	0.0388
19	0.1413	0.1634	0.1091	0.0603	0.0441	0.0294
23	0.8015	0.9350	0.6523	0.4144	0.3055	0.2129
25	0.5229	0.6122	0.4326	0.2939	0.2174	0.1534
29	0.0271	0.0319	0.0229	0.0177	0.0132	0.0094
31	0.0258	0.0305	0.0221	0.0180	0.0134	0.0097
35	0.2910	0.3459	0.2523	0.2289	0.1720	0.1253
37	0.3449	0.4112	0.3009	0.2868	0.2161	0.1580
41	0.0146	0.0175	0.0129	0.0135	0.0102	0.0075
43	0.0188	0.0225	0.0166	0.0181	0.0138	0.0101
47	0.2939	0.3554	0.2632	0.3105	0.2373	0.1755
49	0.2892	0.3508	0.2602	0.3186	0.2440	0.1809
THD	4.207209	4.592489	1.7164	1.264466	0.906725	0.4717

#### 3.2 Recommendation

A combined harmonic filter as indicated in Scenario 3 would compensate the low power factor from 59.1% to 93.8% and would keep the harmonic distortion within IEEE 519 limits.

The budget price for such filter is of US\$250,000.00

## **4. APPENDIX**

### **4.1 One Line Diagram**

## **4.2 Thermoelectric Solutions Inc. Survey**

### **4.3 Illuminating Company Report**