
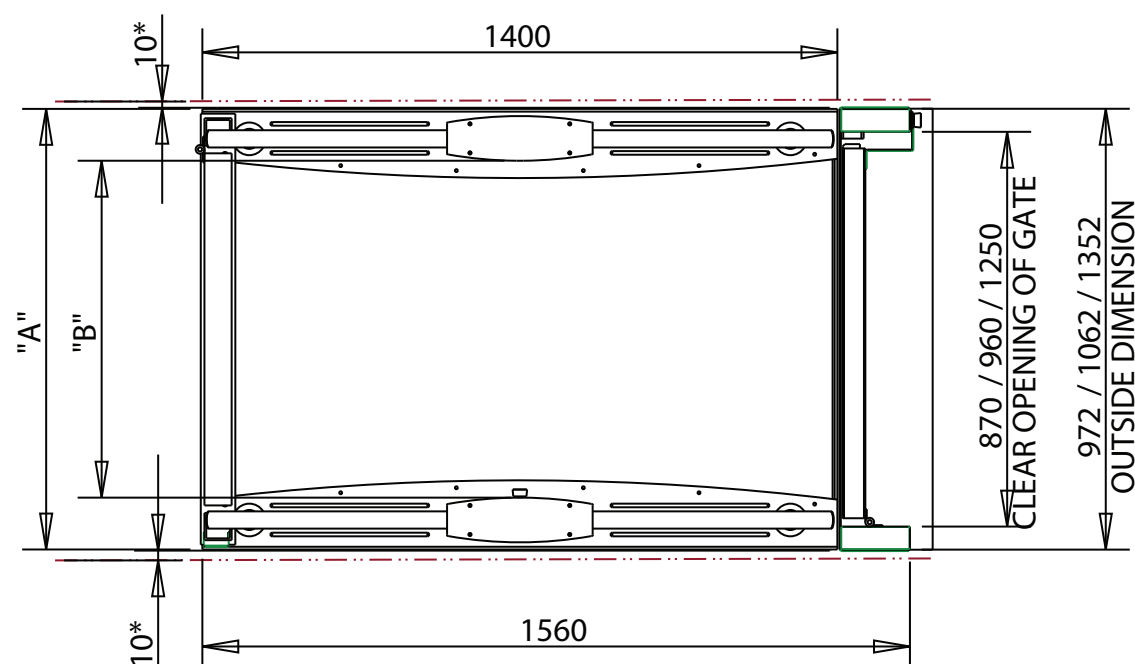
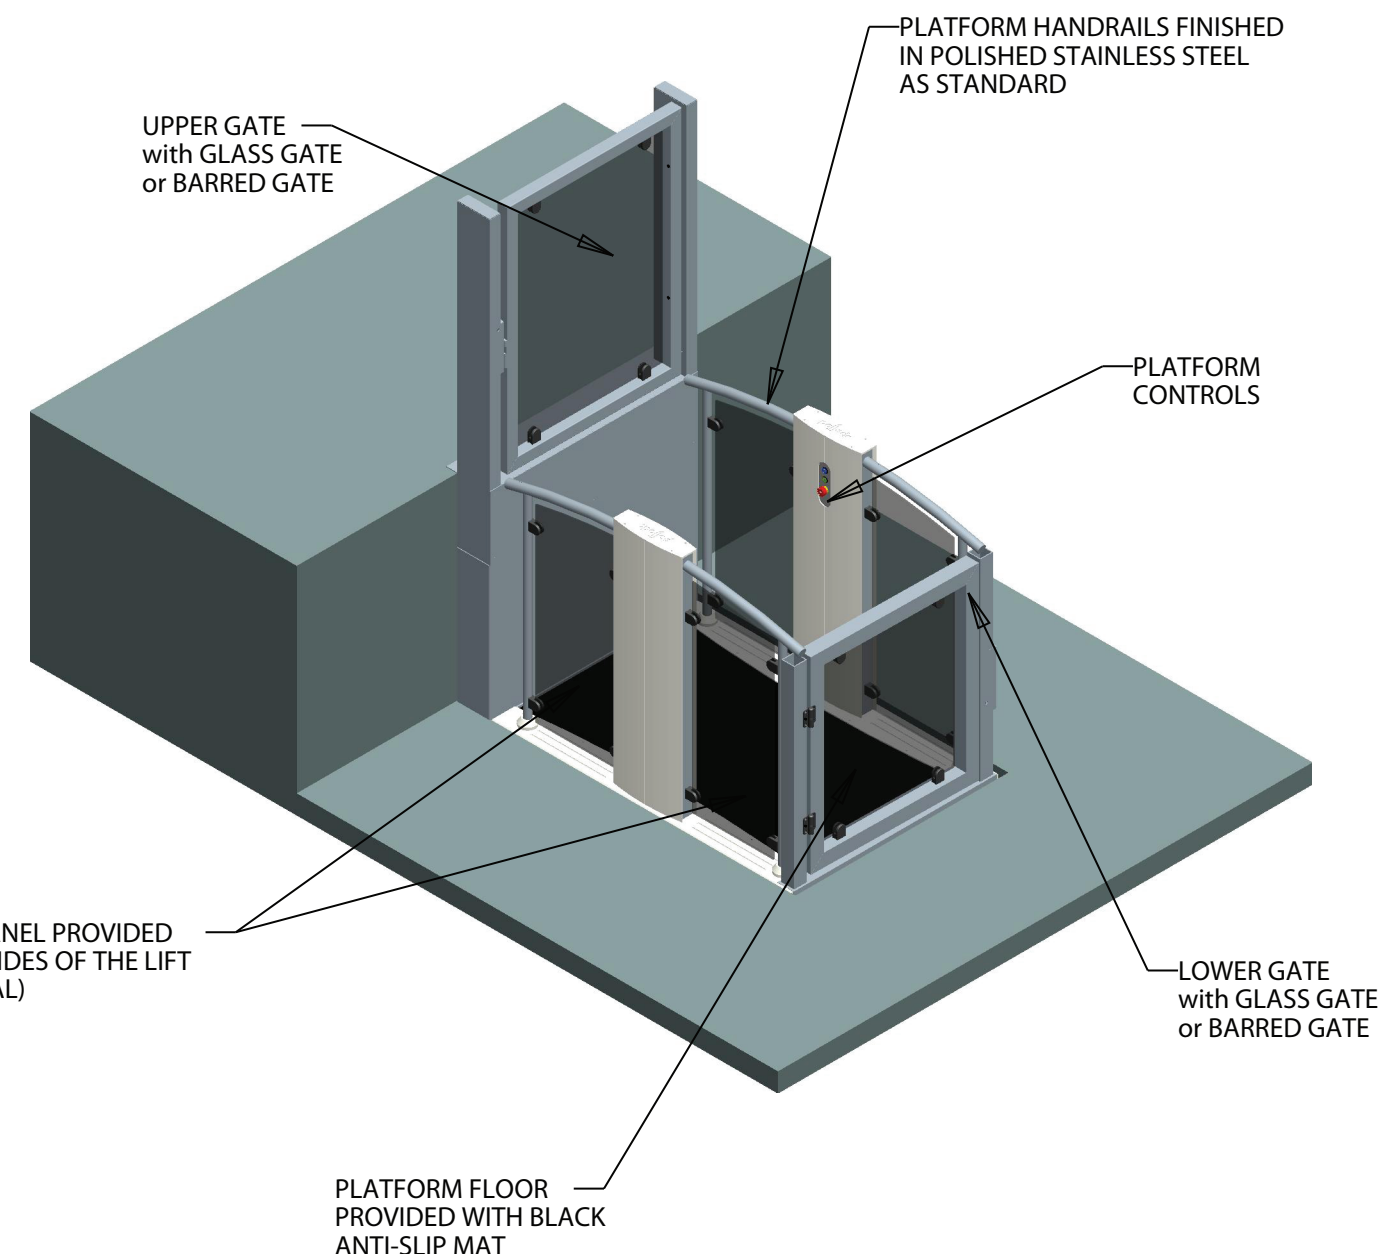



Steplift SIZE	"A"	"B"	"C"
740W	975	740	995
830W	1065	830	1085
1100W	1355	1120	1375

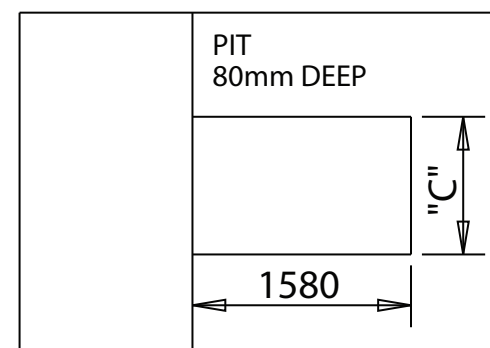

CLEARANCE EITHER SIDE OF STEPLIFT MUST BE <10mm OR >150mm TO COMPLY WITH BS6440.

PIT EDGES MAY NEED TO BE INFILLED AROUND LIFT BY BUILDER AFTER LIFT INSTALLATION.

Drawing Title: A2 Step Lift - Through Entry Pit Mounted		Drawing Number: -
Date: 24/01/12	Scale: NTS	Rev:
Drawn By: N Massey	Checked By: N Cardwell	
Unit 7, Deanfield Drive, Link 59 Business Park, Clitheroe, Lancs, BB7 1QJ, Tel: 01200 405005 Fax: 01200 405006 Email: info@axess2.co.uk		axess  Lifts for life www.axess2.co.uk